


IGLU INUIT MONO SCHEME

1. Freeze Protection (Choose One):
A) Antifreeze valves (for both outdoor pipes)
B) 25%- 35% glycol in the system fluid
C) Heated cables (for both outdoor pipes)
2. Air relief valves should be used at the highest point of the system.

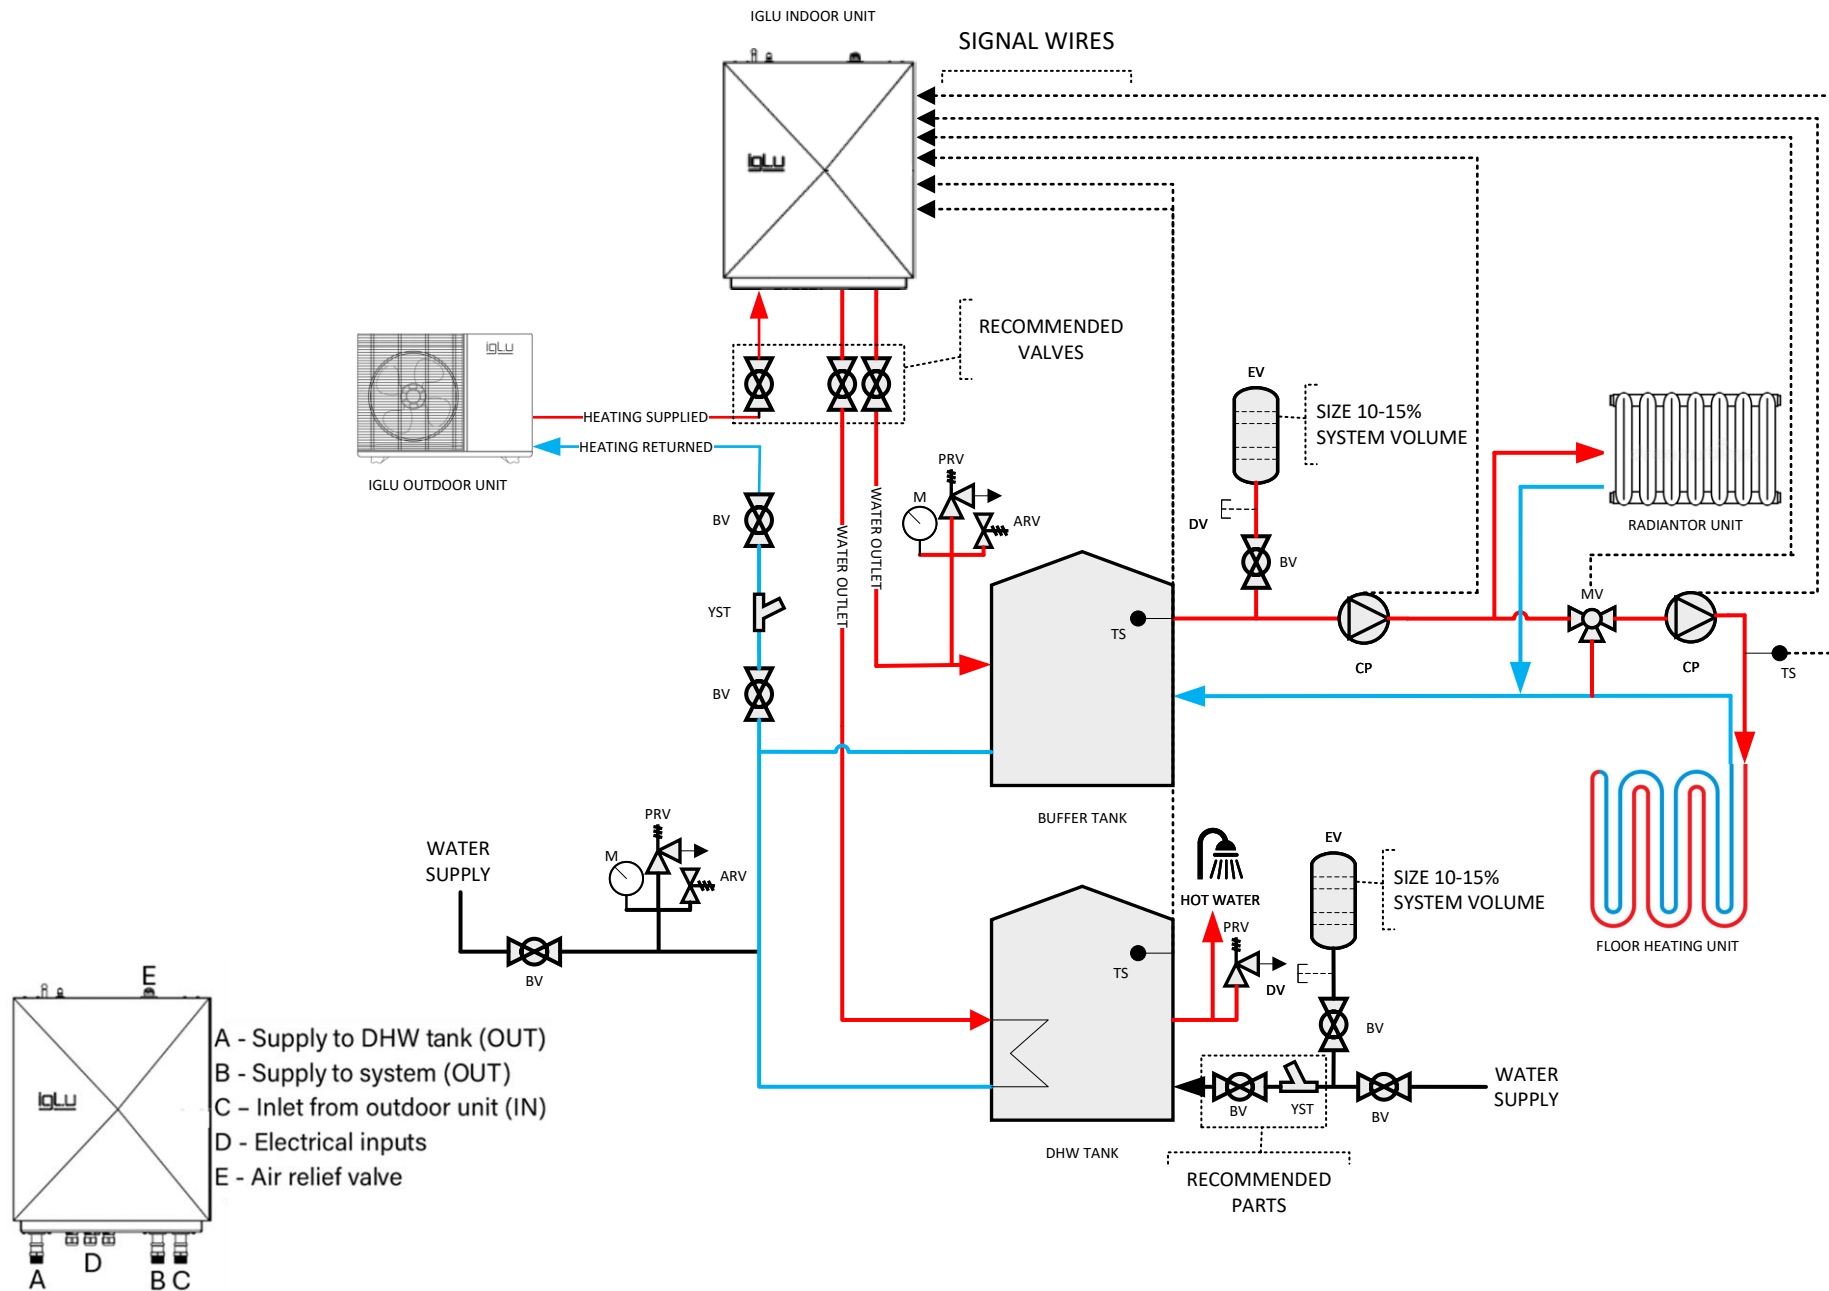

Hot line	
Cooled line	
External lines	
Electrical wires	