


MAX CLASSIC SCHEME

1. Freeze Protection: 25%- 35% glycol in the system fluid.

2. Air relief valves should be used at the highest point of the system.

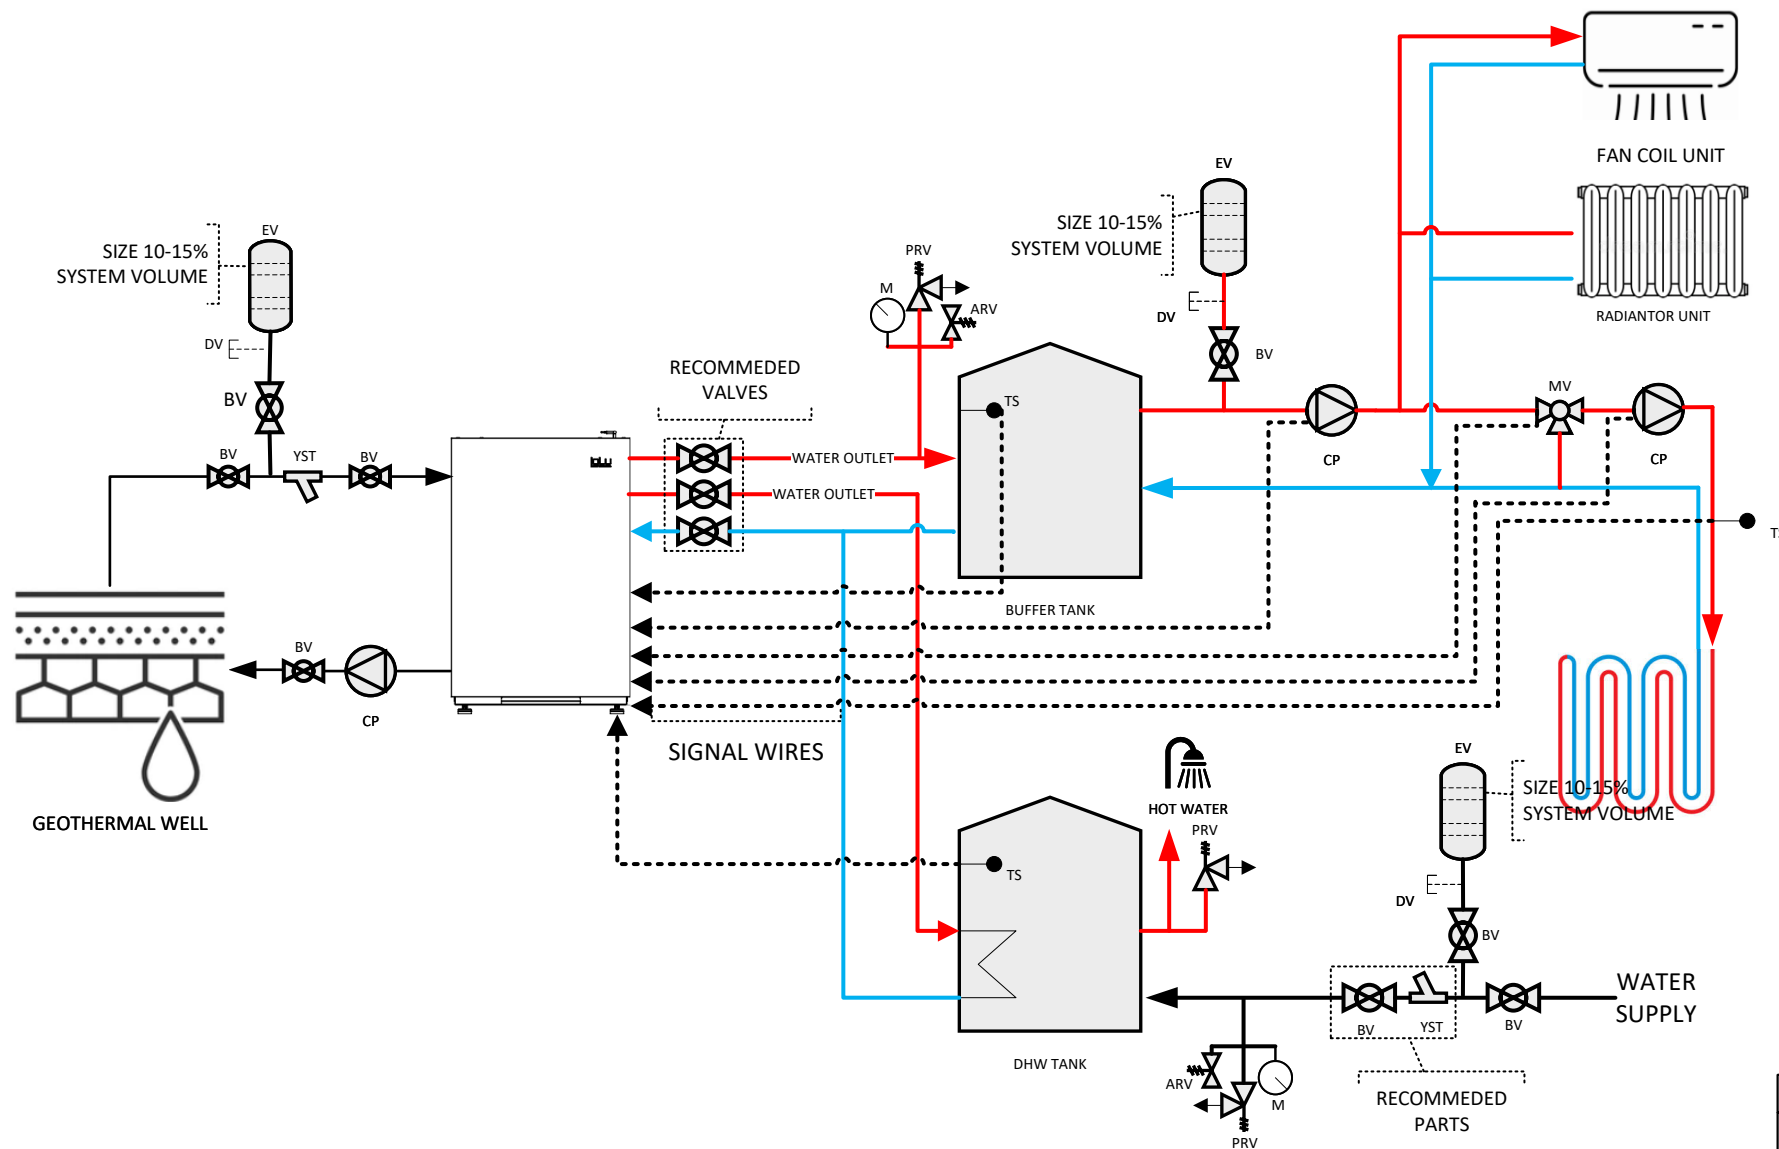

Hot line	
Cooled line	
External lines	
Electrical wires	