


1. Freeze Protection: 25%- 35% glycol in the system fluid.
2. Air relief valves should be used at the highest point of the system.

IGLU ALEUT I SCHEME

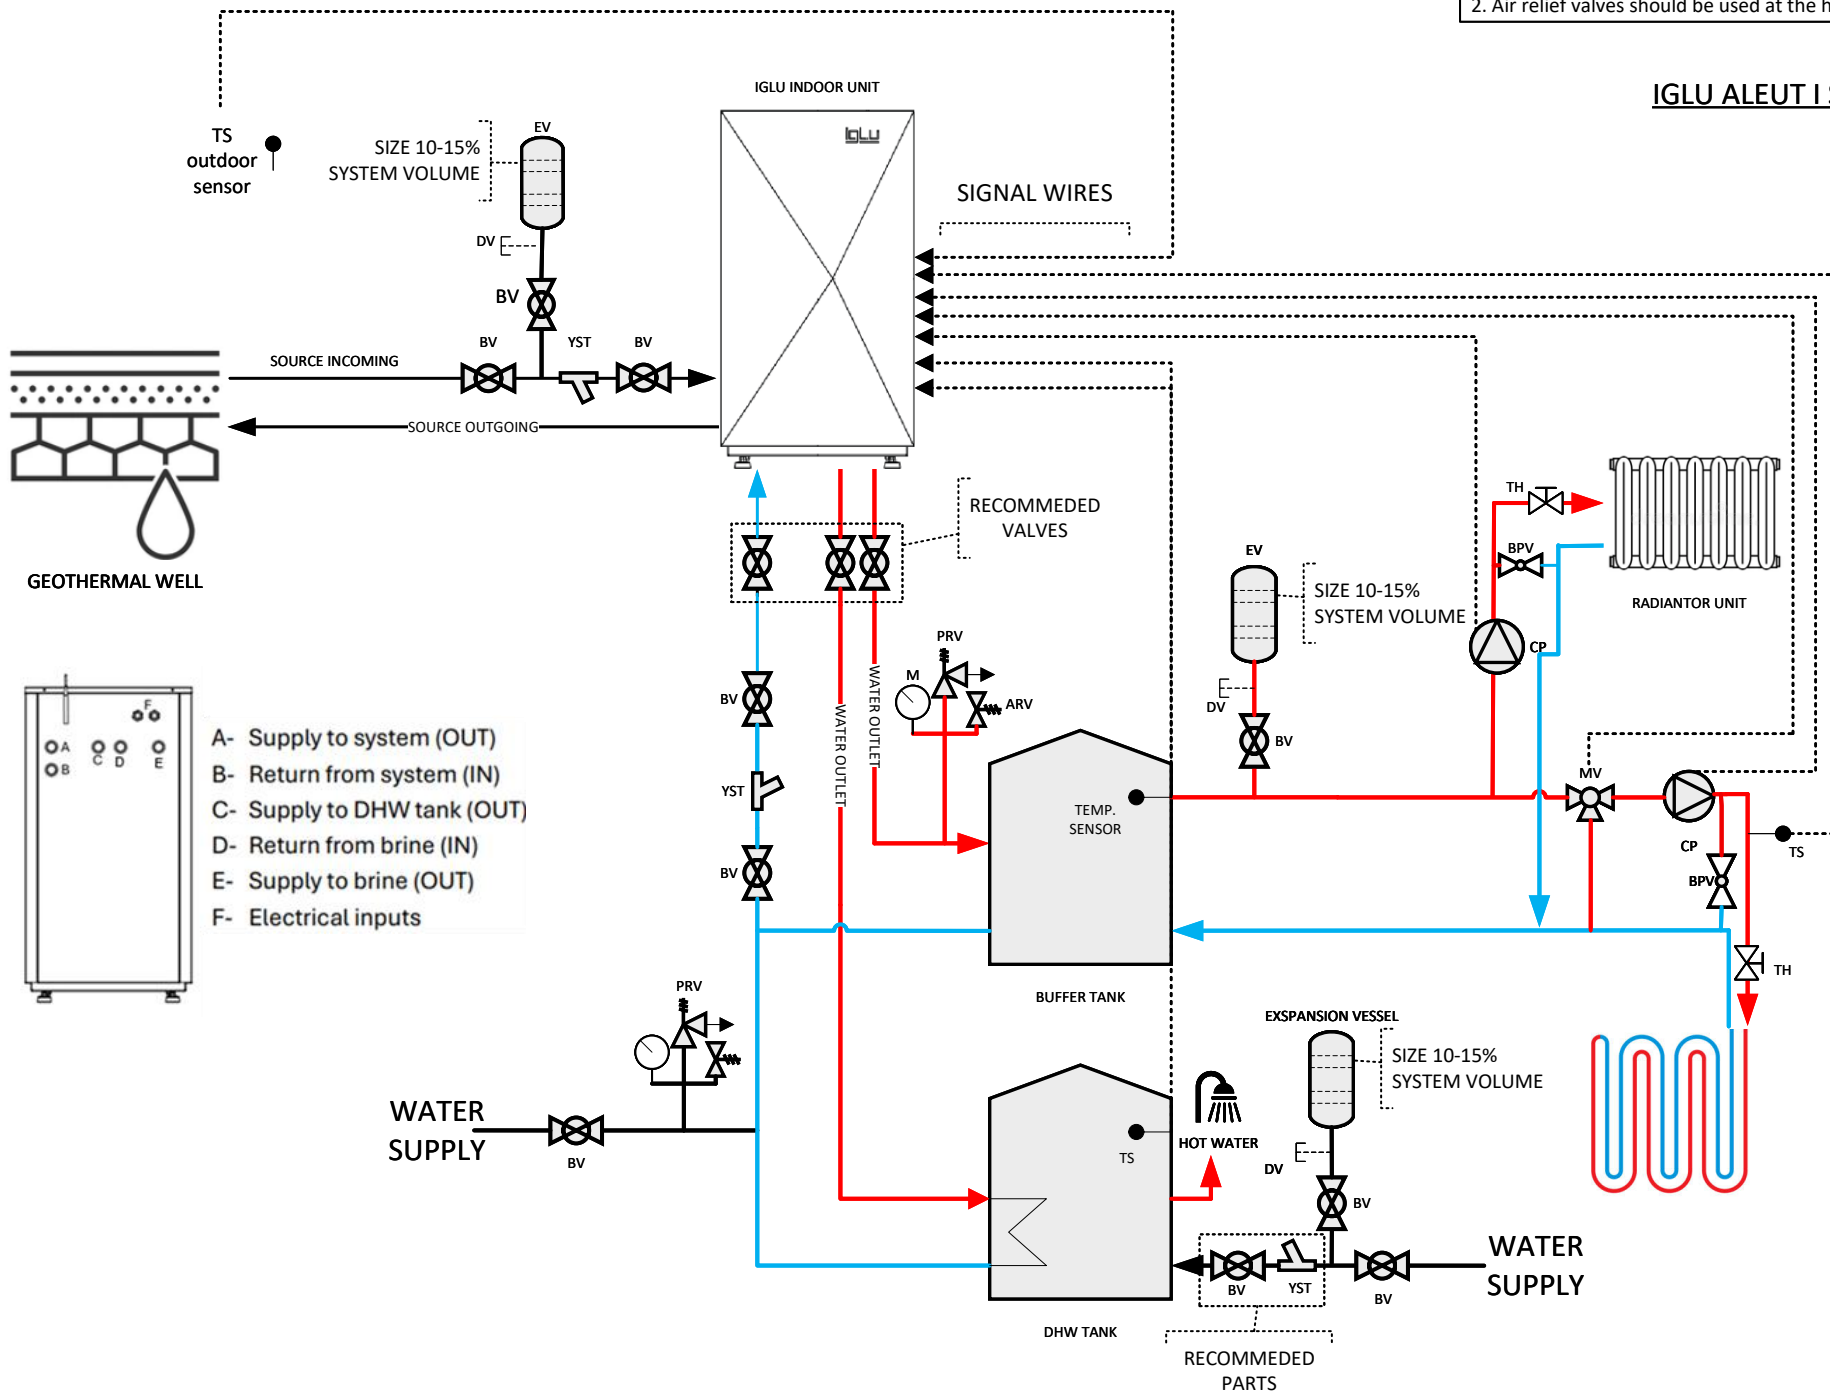

- A- Supply to system (OUT)
- B- Return from system (IN)
- C- Supply to DHW tank (OUT)
- D- Return from brine (IN)
- E- Supply to brine (OUT)
- F- Electrical inputs

Hot line	
Cooled line	
External lines	
Electrical wires	