
MAX CLASSIC SCHEME

1. Freeze Protection: 25%- 35% glycol in the system fluid.
2. Air relief valves should be used at the highest point of the system.

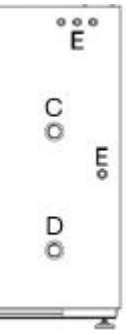

A - Supply heating water connection nozzle
B - Return heating water connection nozzle
C - Incoming glycol connection nozzle
D - Outgoing glycol connection nozzle
E - Heat pump cable input

Hot line
Cooled line
External lines
Electrical wires